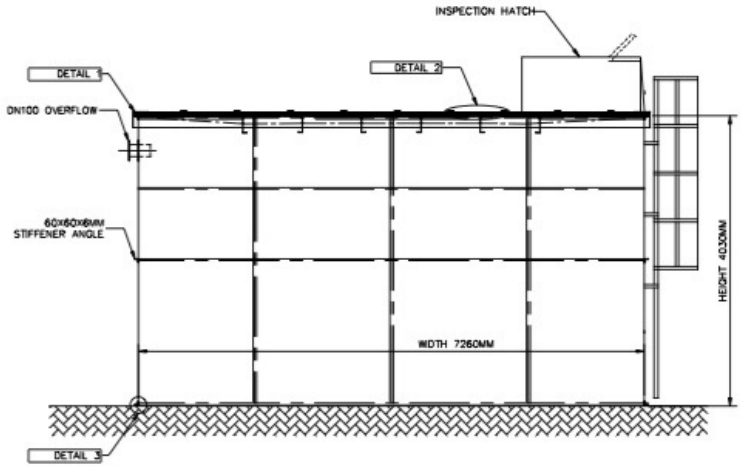

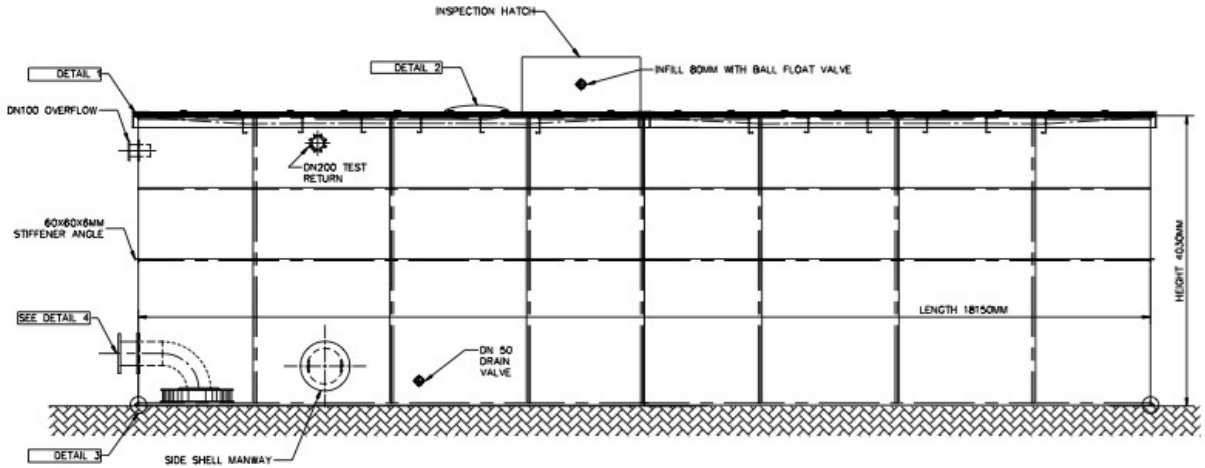

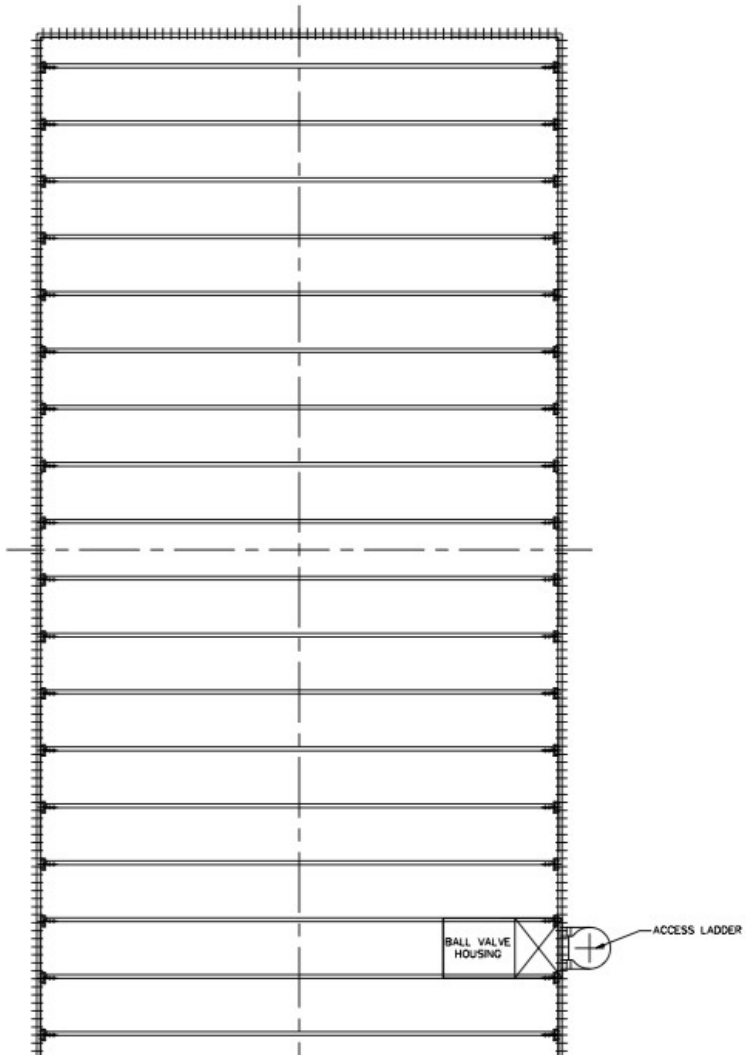

NOTES:
1: ALL DIMENSIONS IN MILLIMETRES
2: ALL STRUCTURAL STEELS TO BE TO EN4360
3: ALL NUTS, BOLTS & WASHERS TO BE SPUN GALVANISED
4: STEEL ITEMS TO BE HOT DIP GALVANISED EN ISO 1461:1999
5: GENERAL FABRICATION TOLERANCE FOR DIMENSIONS OF UP TO 1.0 METRE TO BE + OR − 1mm
TOLERANCE FOR DIMENSIONS OVER 1.0 METRE TO BE +/− 2mm
6: ALL PIPE FLANGES TO BE TO EN4504 PN16
7: ALL FOUNDATION DETAILS TO BE USED AS A GUIDE ONLY. FOUNDATION DESIGN MAY ALTER DUE TO GROUND CONDITIONS

PART/FLANGE CONNECTION SCHEDULE

ITEM No.	SIZE	No. OFF	DESCRIPTION
1.	DN80	1.	INFILL
2.	DN100	1.	OVERFLOW
3.	DN300	1.	SUCTION
4.	DN600	1.	MANWAY
5.	DN200	1.	TEST RETURN
6.	DN50	1.	DRAIN VALVE

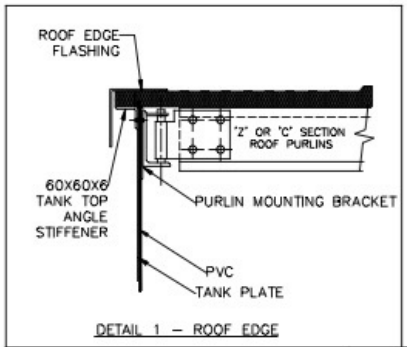

DETAIL 1 – ROOF EDGE

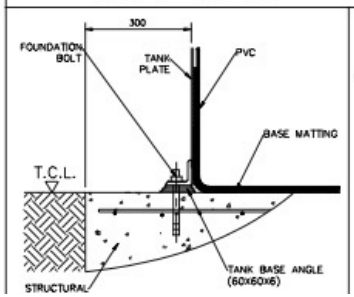

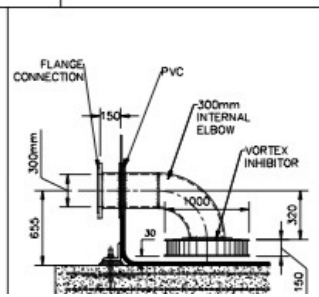

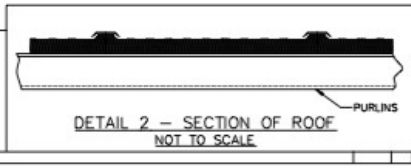

DETAIL 2 – SECTION OF ROOF
NOT TO SCALE

REV	REVISION	DATE	BY	APP.

GENERAL ARRANGEMENT OF CLIMATE/1554 GALVANIZED TANK
FOR:

Climate Inc.

DRAWN BY	GROUP NO.	DATE	DWG NO.
CHECKED BY	APPROVED BY		CLIMATE.152